

PRATT

Henry Pratt Company

Triton XR-70

and Triton XL



Valves for the 21st Century



A Tradition of Excellence

With the development of the first rubber seated butterfly valve more than 70 years ago, the Henry Pratt Company became a trusted name in the flow control industry, setting the standard for product quality and customer service. Today Pratt provides the following range of superior products to the water, wastewater and power generation industries.

BUTTERFLY VALVES: from 3" to 162"

RECTANGULAR VALVES: 1' x 1' to 14' x 16'

BALL VALVES —

RUBBER SEATED: from 4" to 60"

METAL SEATED: from 6" to 48"

PLUG VALVES: from 1/2" to 36", 3 ways

HYDRAULIC CONTROL SYSTEMS

VALVE CONTROLS

ENERGY DISSIPATING VALVES

AND FIXED ENERGY DISSIPATERS

CONE VALVES

CHECK VALVES

A Commitment to Meeting The Customers' Needs

Henry Pratt valves represent a long-term commitment to both the customer and to a tradition of product excellence. This commitment is evident in the number of innovations we have brought to the industries we serve. In fact, the Henry Pratt Company was the first to introduce many of the flow control products in use today, including the first rubber seated butterfly valve, one of the first nuclear N-Stamp valves, and the bonded seat butterfly valve.

Innovative Products For Unique Applications

Though many of the standard valves we produce are used in water filtration and distribution applications, Pratt has built a reputation on the ability to develop specialized products that help customers to meet their individual operational challenges.

Creative Engineering for Fluid Systems

Pratt's ability to provide practical solutions to complex issues is demonstrated by the following case histories.

Earthquake Proof Valves

Pratt designed and manufactured hydraulically actuated valves for a water storage application so that the valves would automatically operate in the event of earthquakes. This led to the development of a valve that will withstand forces of up to 6g's.

Custom Actuation/ Isolation Valves

Pratt designed and manufactured valves that would isolate a working chamber in the event of a nuclear emergency during the decommissioning of armed nuclear warheads. The valves were able to close in a millisecond using specially designed Pratt electro-pneumatic actuators.

Valves Designed for Harsh Environments

Pratt designed and manufactured a 144" diameter butterfly valve for the emergency cooling system at a jet engine test facility. The valve was designed to supply water to help dissipate the tremendous heat generated by the engines during testing.

PRATT

Henry Pratt Company

Through experience, commitment and creative engineering, Pratt is uniquely suited to provide superior products for our customers' special needs. For more information, contact our corporate headquarters in Aurora, Illinois.

TABLE OF CONTENTS

SCOPE OF LINE - 24 TO 144 INCHES

XR-70 BUTTERFLY VALVE	1
MODEL TRITON XL BUTTERFLY VALVE	1
MATERIALS OF CONSTRUCTION	1-2

FEATURES AND BENEFITS OF RUBBER SEATED BUTTERFLY VALVES

TRITON XR-70 AND TRITON XL	2
----------------------------------	---

DESIGN DETAILS

TRITON XR-70 AND TRITON XL	3-4
----------------------------------	-----

PRODUCT DATA

E-LOK SEAT DESIGN	5
FLOW THROUGH DISC	5
COATINGS AND RUBBER LININGS	6
WATER FLOW CHARACTERISTICS	7

VALVE END TYPES AND DIMENSIONS

TRITON XR-70	8-10
TRITON XL	11-12

SUGGESTED SPECIFICATIONS (CAST)

13

SUGGESTED SPECIFICATIONS (FABRICATED)

14

ACTUATION

15

SALES REPRESENTATIVE OFFICE LISTING.

16

SCOPE OF LINE: TRITON XR-70 AND TRITON XL



TRITON XR-70 BUTTERFLY VALVE

Sizes: 24 through 72 inches

Body Styles:

- Flange x flange ends
- Mechanical Joint ends
- Victaulic ends
- Concrete Pipe ends

Standards:

- Conforms to AWWA C504 requirements

Pressure Class:

- AWWA pressure classes 25B, 75B and 150B

Seat: Rubber seat-in-body

Actuation Options:

- Pratt MDT manual actuator with AWWA nut, handwheel or chainwheel
- Worm gear actuators
- Pratt Dura-Cyl hydraulic or pneumatic cylinder

Accessories/Options:

Anti-cavitation device, bonnets, floorstands, lantern glands, shaft locking devices, external epoxy injection port, snubbers, expansion joints, rubber lining

Consult factory for accessory details.

TRITON XL BUTTERFLY VALVE

Sizes: 24 through 144 inches

Body Styles:

- Flange x flange ends
- Flange x weld ends
- Weld x weld ends
- Weld x flange ends

Pressure Rating:

- 100 micron vacuum to 150 psig in several pressure classes

Seat: Rubber seat-in-body

Actuation Options:

- Pratt MDT manual actuator with AWWA nut, handwheel or chainwheel
- Worm gear actuators
- Pratt Dura-Cyl hydraulic or pneumatic cylinder

Accessories/Options:

Anti-cavitation devices, bonnets, floorstands, lantern glands, shaft locking devices, external epoxy injection port, snubbers, expansion joints, rubber lining

MATERIALS OF CONSTRUCTION

Standard Material Code	Type of Material				
	Body	Disc	Disc Edge	Shaft	Bearing
542 (XR-70)	Cast Iron	Ductile Iron	316 S.S.	304 S.S.	TLFB*
548	Fab. Steel	Fab. Steel	316 S.S.	304 S.S.	TLFB*

Other materials available upon request

**See material specifications table*

FEATURES AND BENEFITS: TRITON XR-70 AND TRITON XL

FEATURE

- ☐ E-Lok seat in design
- ☐ Rubber seat located in body
- ☐ Optional external injection port
- ☐ Seat material also available in EPDM
- ☐ Valve cycle tested per AWWA C504 requirements
- ☐ Flow through disc on 30 inch and larger
- ☐ Nonmetallic bearings
- ☐ V-type shaft packing
- ☐ Through disc pinning

BENEFIT


- ☐ No hardware to loosen. Rubber not preloaded and uniform interference to provide long seat life. Foolproof adjustment and/or replacement (in most cases without removing the valve from the line)
- ☐ Reduces performance problems related to corrosive buildup in valve body and pipeline.
- ☐ E-Lok seat can be adjusted and/or repaired in the field without dewatering the pipeline
- ☐ Can accommodate temperatures up to 250 degrees F
- ☐ Proven reliability over the life of the valve
- ☐ More strength, less weight, greater free flow area. Higher C_v : lower head loss results in energy savings for customer's system
- ☐ Prevents galvanic corrosion and provides lower coefficient of friction
- ☐ Self-adjusting, lasts the life of the valve
- ☐ Provides a tight disc-to-shaft pin connection, greatly reducing the possibility of loosening through vibration

Specifications for Materials of Construction
Body Material: Cast Iron — ASTM A126, Class B Fabricated Steel — ASTM A36 (XL)
Disc Material: Ductile Iron — ASTM A536, Grade 65-45-12 Fabricated Steel — ASTM A36 (XL)
Disc Edge: Stainless Steel — ASTM A-240 Type 316
Shaft Material: 304 Stainless Steel — ASTM A276 Type 304
Bearing Material: TLFB — Teflon lined, Fiberglass backed

DESIGN DETAILS: TRITON XR-70 AND TRITON XL


CAST VALVES:

Flange x Flange

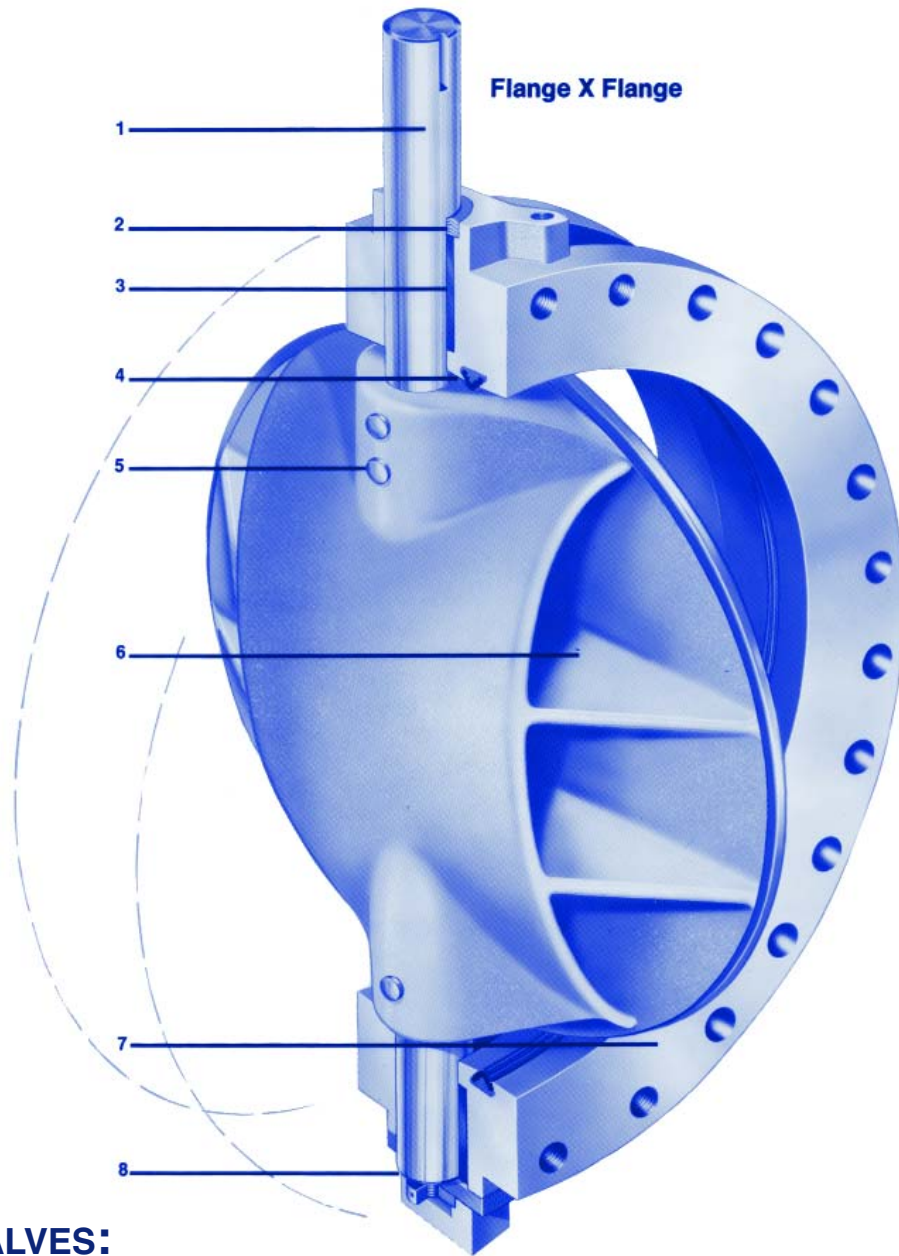


FABRICATED VALVES:


Flange x Flange

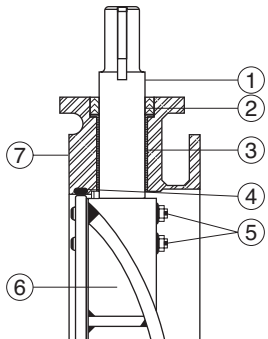

Weld x Weld End

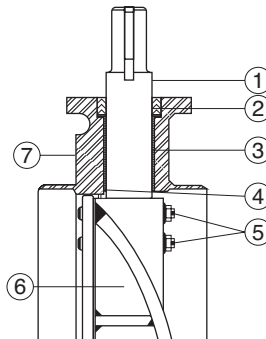

Flange x Weld End

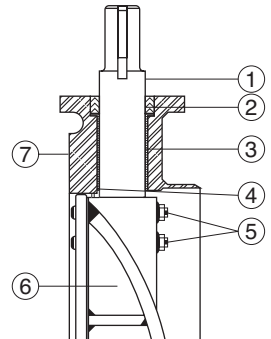

DESIGN DETAILS: TRITON XR-70 AND TRITON XL

1) Corrosion Resistant Shafts

To prevent corrosion of a vital structural component, shafts are constructed of centerless ground ASTM A276 type 304. This material is superior to carbon steel or similar materials that afford little protection against the harmful effects of corrosion. Pratt's standard line consists of a two-piece, stub-type shaft keyed for the actuator connection.

2) Packing and Packing Gland Assemblies

Packing is self adjusting "V" type. The packing gland or shaft seal is utilized only in the top trunnion of the valve body where the shaft protrudes for actuator connection. The packing assembly incorporates a nylon packing retainer accompanied by several rings of packing. Other available packing gland arrangements include water seals (lantern glands) for positive and negative pressures, and reverse "V" type for vacuum applications. Where access to packing is required, open-type bonnets can be provided. When this option is specified, "V" type packing is held in place with a bronze retaining gland which is fastened to the valve trunnion with plated steel cap screws.

3) Bearings

Self-lubricating, sleeve-type bearings are used in both trunnions of the valve body. Bearings support the shaft and provide minimum friction during shaft rotation. Bearing material is Teflon-lined with a special fiberglass backing. This type of bearing offers electrical insulating qualities between the disc/shaft assembly and the valve body, thereby diminishing the effects of galvanic corrosion. In addition, its reduced coefficient of friction requires far less torque than the metallic bearing materials.

4) Rubber Seat

The multi-ridge surface of Pratt's E-Lok seat seals a full 360° against a stainless steel spherical disc edge. Because of the laterally spaced grooves, rubber stress is substantially reduced, resulting in less sealing torque. The grooved seat design, coupled with the wide spherically shaped seating edge of the disc, also allows greater disc closure tolerance. Regardless of valve size, angular misposition of the disc can be 1° off center without leakage. The seat is mechanically retained by a unique epoxy injection process which moves the seat against the disc to conform to the exact radius of the disc with uniform contact pressure. It is fully adjustable by local epoxy injection and can be replaced in the field. As an option, valves may be purchased with an external injection port which allows seat adjustment and repair to be performed without removing the valve or dewatering the pipeline. For additional information regarding the E-Lok seat, refer to the "E-Lok Seat Design" section of this brochure.

5) Shaft Connection

Disc-to-shaft connection is accomplished by conservatively sized stainless steel or monel taper pins, threaded at one end and secured with lockwashers and nuts. On 24 inch valves, stainless steel dowel pins are used. Pratt's through-pin design provides the tightest possible connection between the shaft and disc.

6) Valve Disc

Pratt valve discs are constructed of the highest strength-to-weight ratio materials available. On our 24 inch valve, the arch side of the disc is closed and the flat side is open, forming a slightly concave surface. On valves 30 inches and greater, a flow through disc design is employed to minimize line turbulence and lower head loss. The greater free flow area provides less pressure drop in the full-open position than other disc shapes. For additional information regarding Pratt's flow through disc design, refer to "Flow through Design" section of this brochure.

7) Valve Body

The bodies of the XR-70 are constructed of heavy cast iron ASTM A126. For XL's, fabricated steel ASTM A36 is used and designed to meet pressure and flow requirements. On flange end bodies, flange drilling is provided in accordance with ANSI B16.1 for cast iron flanges through 72 inches. Larger sizes where applicable per AWWA C207.

8) Thrust Bearing Assembly

The two-way thrust bearing is preset at the factory. On valves 30 inches and larger, the thrust bearing assembly consists of a stainless steel or monel stud fastened to the bottom of the valve shaft. The stud extends beyond the bottom cover. The thrust collar is threaded to the stud and pinned. On the 24 inch valve, the thrust collar is pinned to the shaft and fitted with bronze spacers. The bottom cover cap is then bolted to the bottom cover and retains the thrust collar which, in turn, retains the position of the disc assembly. The cavity containing the thrust collar is packed with grease providing lifetime lubrication of the thrust bearing assembly. The cap is fully gasketed to prevent leakage.

Valve End Connection Options

A wide range of valve end connection options for the Pratt Triton XR-70 and Triton XL are available. See "Valve End Types and Dimensions: Triton XR-70 and XL-70" section for details.

Actuation Options

See "Actuation" section for Pratt actuators or refer to Pratt's Actuator brochure for the many actuation options available for the Triton XR-70 or Triton XL.

E-LOK SEAT DESIGN: TRITON XR-70 AND TRITON XL

Years of Reliable Service

Both the XR-70 and Triton XL utilize the unique and patented* E-Lok seat-in-body design. With years of reliable performance, the E-Lok's seat retention system still remains one of the most innovative concepts in butterfly valve seat design. This design is often imitated without the superior results that only Pratt experience can deliver.


How the E-Lok Seat Provides Bubble-Tight Closure

The rubber seat, which is mounted in the valve body, seals a full 360° against a stainless steel disc edge with low torque and high tolerance to seating angle. The ridges molded into the seat surface greatly reduce the possibility of the seat being over compressed and minimizes compression set of rubber. In manufacturing, a two part epoxy compound is injected into a channel behind the rubber seat with the disc in the closed position. This ensures equal interference around the complete circumference of the disc/seal contact area. The epoxy hardens, bonding neither to the metal seat channel nor to the rubber seat, yet mechanically retains the seat in the body. Since the seat is installed and remains in a "relaxed" state, the possibility of damaging the seat is greatly reduced as compared to a seat that is "stressed" when bolted on to a body or disc as in other designs.

During injection, the seat is moved against the disc as the epoxy fills the cavity to provide uniform disc-to-seat interference around the entire seating surface. The result is the bubble tight closure. This system eliminates conventional seat retention hardware that can loosen and corrode, potentially damaging pumps and other costly auxiliary equipment.

Simple Seat Adjustment

Another significant feature of the E-Lok seat is that it can be easily adjusted or replaced in the field while the valve is installed in the line. Adjustment is achieved by local injection of epoxy directly through the seat material into the channel behind the seat. The epoxy travels the circumference of the valve body channel until it finds the void and moves the seat material outward toward the disc edge, bringing the valve back into bubble tight condition. If the valve was supplied with the optional** external injection port, the seat can be adjusted from the

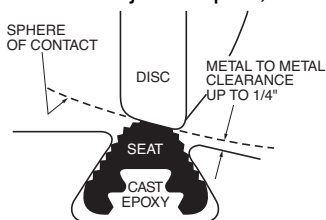


outside of the valve without dewatering the pipeline. The injection process can be achieved by utilizing simple tools and an inexpensive, disposable seat injection kit.

Easy Seat Replacement

In the unlikely event that seat replacement is required, it can be performed on valves 30 inches and larger without removing the valve from the pipeline (as long as a technician can access inside the valve), on all sizes without removing the shaft and/or disc. The original rubber seat and hardened epoxy compound used to retain the seat can be removed from the valve with ordinary hand tools. A replacement seat can then be installed, returning the valve to its original bubble tight condition.

FLOW THROUGH DESIGN:

The Triton disc design distributes material where it is needed to resist loads, achieving more strength at less weight than any other disc design currently on the market. The flow through disc has a greater free flow area than conventional lens-shaped or offset disc designs, resulting in lower pumping costs.

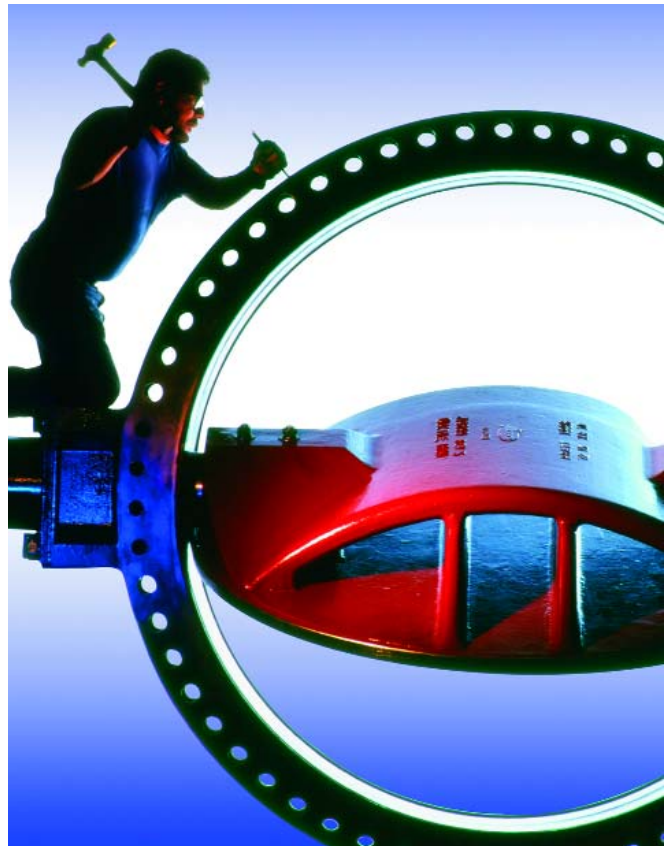

* U.S. Patent Nos. 3,304,050 and 3,418,411

** U.S. Patent No. 5,538,029

COATINGS AND RUBBER LININGS: TRITON XR-70 AND TRITON XL

Withstanding Harsh Conditions and the Test of Time


In many industrial facilities, valves are regularly subjected to harsh conditions, including recirculating water loops where corrosiveness increases each time the water passes through the system, and cooling water systems which utilize brackish water or salt water as a medium. This is especially true at fossil and nuclear power generating plants, which frequently use sea water as their main cooling water resource.

To combat the damaging effects of these harsh conditions, Pratt utilizes epoxy coatings and rubber linings in conjunction with superior design features to help ensure that the Triton XR-70 and XL butterfly valves will withstand the test of time.

The unique construction of the Pratt Triton rubber seated butterfly valve makes both epoxy coatings and rubber linings much more effective than other butterfly valve designs. Since all surfaces of the Triton disc are exposed, there is no possibility for corrosion to start in hidden, unprotected areas like the inside of a hollow, lens-shaped offset disc. Since there is no seat retention hardware, coating and/or lining breakdown in this area is also eliminated.

In applications involving salt water and/or entrained solids which can cause erosion, the superiority of rubber lining on the valve disc has been clearly demonstrated by Pratt butterfly valves placed in service decades ago that are still providing bubble tight closure today. Both epoxy coating and rubber lining have also successfully protected the valve bodies in these corrosive service conditions as illustrated by Pratt's long track record of quality and reliability at industrial facilities and power plants around the world.

Other rubber lining features include Pratt's shaft-bearing being thoroughly protected by rubber shaft seals to maintain bearing performance throughout the life of the valve. Also, the shaft bore in disc is sealed with a rubber seal. The juncture of the rubber liner to the rubber seat is also protected by a sealant applied under pressure.

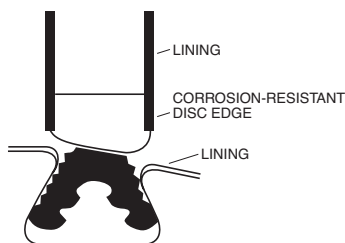


Complete coverage of corrosion susceptible wetted surfaces is demonstrated in these drawings. Body lining in conjunction with the seat creates a water barrier and protects against corrosion.

Rubber Linings

Pratt lines corrosion-susceptible surfaces with a $\frac{3}{16}$ -inch thick rubber of 60 Shore A durometer. The surfaces are prepared and blasted to a near-white metal finish. The linings are applied by the "hand-lay-up-method" (similar to tank lining techniques) and then cured in an open steam autoclave using 40 to 50 psig steam pressure. Following application and curing, the linings are visually inspected for air bubbles and checked at 7,000 volts with a positive control high-voltage spark tester.

Epoxy Coatings

Pratt has an extensive coating facility which applies and cures coatings in a controlled environment. Prior to application of the epoxy, valves are sandblasted and thoroughly cleaned to ensure a proper bond. The interior and external surfaces of each valve are coated with a Polyamide-cured, rust inhibiting epoxy, NSF approved. A magnetic dry film thickness gauge is used to confirm that the coating thickness matches the project/order specification requirements. Electronic testing for pin holes (holidays) is performed.

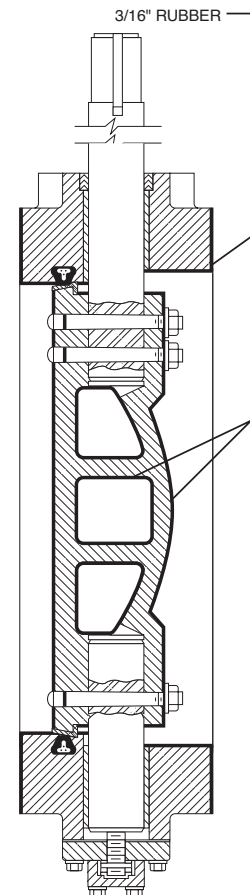

WATER FLOW CHARACTERISTICS: TRITON BUTTERFLY VALVES

PROVEN PERFORMANCE

During its product development phase, the Triton butterfly valve was tested to ensure that it met our own rigorous standards for flow capacity. The Triton butterfly valve consistently produced high C_v values which translates to lower flow resistance, in turn, lowering system operating costs to the user over the life of the valve.

FULL OPEN C_v VALVES TRITON XR-70 VALVES CLASS 150B


SIZE	FLAT	ARCH
24	25380	26378
30	39657	41216
36	59351	62447
42	85899	89170
48	112195	116466
54	141808	146563
60	172343	176486
66	208535	213548
72	248174	254139
78	291260	298261
84	337793	345912
90	387772	397093
96	441199	451803
102	498072	510043
108	558392	571813
114	622159	637113
120	689373	705942
132	834171	854190
144	992697	1016557

FULL OPEN C_v VALVES TRITON XR-70 CLASS 75B XL 50-75 PSI

SIZE	FLAT	ARCH
30	41461	44301
36	69750	70795
42	94937	96360
48	124000	125858
54	159289	161194
60	196654	199005
66	237951	240796
72	283181	286567
78	332345	336318
84	385441	390049
90	442471	447761
96	503433	509452
102	568329	575124
108	637158	644776
114	709920	718407
120	786615	796019
132	951804	963183
144	1132725	1146268

VALVE END TYPES AND DIMENSIONS: TRITON XR-70

FLANGED END

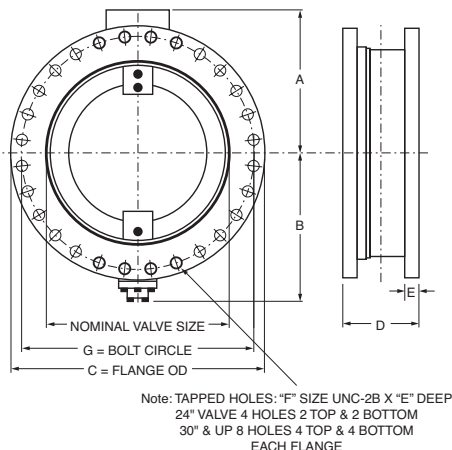


Notes:

- ☐ Dimensions shown in inches.
- ☐ Size = Nominal valve size.
- ☐ For bolts smaller than 1¼ inches in diameter, bolt holes will be ⅜ inches larger than diameter of bolts. For bolts 1¼ inches in diameter and larger, bolt holes will be ¼ inches larger than diameter of bolts. Dimensions and drilling of end flanges conform to ANSI B16.1 Standard for cast iron flanges.
- ☐ Allow 3½ inches for thrust bearing removal.
- ☐ A, B = Apply to AWWA Classes 25A, 25B, 75A, 75B.
- ☐ AA, BB = Apply to AWWA Class 150B.
- ☐ F = Number and size of bolts. 125 lbs. standard. Holes in trunnion area are tapped, see note.

Flanged End Dimensions									
Size	A	B	AA	BB	C	D	E	F	G
24	—	—	18 ⁵ / ₈	18 ³ / ₈	32	8	1 ⁷ / ₈	20-1 ¹ / ₄	29 ¹ / ₂
30	21 ¹ / ₁₆	22 ³ / ₄	21 ¹ / ₂	24 ¹ / ₈	38 ³ / ₄	12	2 ¹ / ₈	28-1 ¹ / ₄	36
36	25 ¹ / ₁₆	26 ¹ / ₂	25 ⁷ / ₁₆	28	46	12	2 ³ / ₈	32-1 ¹ / ₂	42 ³ / ₄
42	29 ¹ / ₁₆	30 ³ / ₈	29 ⁷ / ₁₆	32 ¹¹ / ₁₆	53	12	2 ⁵ / ₈	36-1 ¹ / ₂	49 ¹ / ₂
48	32 ⁵ / ₁₆	34 ⁵ / ₈	34 ¹ / ₁₆	36 ⁷ / ₈	59 ¹ / ₂	15	2 ³ / ₄	44-1 ¹ / ₂	56
54	36 ¹ / ₁₆	38 ¹ / ₂	37 ¹ / ₂	40 ¹¹ / ₁₆	66 ¹ / ₄	15	3	44-1 ³ / ₄	62 ³ / ₄
60	39 ⁵ / ₁₆	42 ¹ / ₁₆	41 ³ / ₄	45 ³ / ₁₆	73	15	3 ¹ / ₈	52-1 ¹ / ₄	69 ¹ / ₄
66	43 ³ / ₁₆	46 ³ / ₄	46 ¹ / ₁₆	49 ¹ / ₂	80	18	3 ³ / ₈	52-1 ³ / ₄	76
72	46 ¹⁵ / ₁₆	55 ⁵ / ₈	50	53 ¹ / ₈	86 ¹ / ₂	18	3 ¹ / ₂	60-1 ¹ / ₄	82 ¹ / ₂

VALVE END TYPES AND DIMENSIONS: TRITON XR-70

MECHANICAL JOINT END

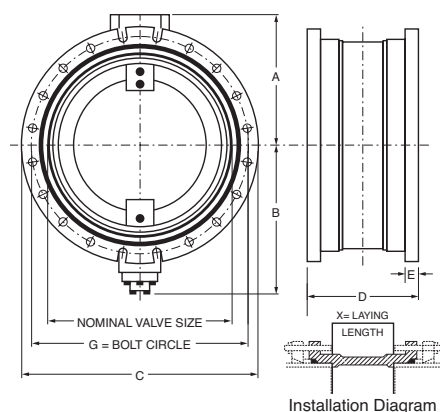


Notes:

- ☐ Dimensions shown in inches.
- ☐ Size = nominal valve size.
- ☐ Bolts, nuts, glands and gaskets not furnished unless otherwise specified in contract.
- ☐ This end style available in AWWA Class 150B only.
- ☐ Allow 3½ inches for thrust bearing removal.
- ☐ F = Number and size of bolts.

Mechanical Joint End Dimensions								
Size	A	B	C	D	E	F	G	X
24	18 ⁵ / ₈	18 ³ / ₈	31 ¹ / ₁₆	13 ¹ / ₄	1 ⁵ / ₈	16- ³ / ₄	30	6 ³ / ₈
30	21 ¹ / ₂	24 ¹ / ₈	39	18	1 ¹³ / ₁₆	20-1	36 ⁷ / ₈	10
36	25 ⁷ / ₁₆	28	45 ⁷ / ₈	22	2	24-1	43 ³ / ₄	14
42	29 ⁷ / ₈	32 ³ / ₄	53	22	2	28-1 ¹ / ₄	50 ⁵ / ₈	14
48	34 ¹ / ₁₆	36 ⁷ / ₈	59 ⁷ / ₈	24	2	32-1 ¹ / ₄	57 ¹ / ₂	16

CONCRETE END

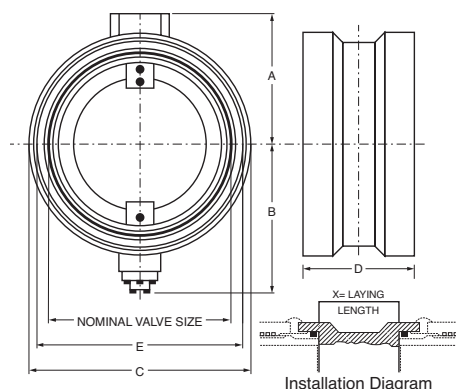

Concrete End Dimensions						
Size	A	B	C	D	E	X
30	21 ¹ / ₂	24 ³ / ₁₆	36 ¹³ / ₁₆	18	34 ³ / ₃₂	11 ¹ / ₂
36	25 ⁷ / ₁₆	28 ¹ / ₁₆	43 ¹³ / ₁₆	22	41 ¹ / ₃₂	15 ¹ / ₄
42	29 ⁷ / ₈	32 ¹¹ / ₁₆	50 ⁷ / ₁₆	22	47 ³ / ₃₂	14 ¹ / ₂
48	34 ¹ / ₁₆	36 ⁷ / ₈	54 ¹³ / ₁₆	24	51 ¹ / ₃₂	16 ¹ / ₄
54	37 ¹ / ₂	38 ³ / ₈	61 ¹ / ₂	24	57 ²⁵ / ₃₂	15 ³ / ₄

Notes:


- ☐ Dimensions shown in inches.
- ☐ Valves 30-42" are SP-5 concrete pipe ends.
- ☐ 48" and larger are SP-12 concrete pipe ends.
- ☐ Size = Nominal valve size.
- ☐ This end style available in AWWA Class 150B only.
- ☐ Allow 3½ inches for thrust bearing removal.

VALVE END TYPES AND DIMENSIONS: TRITON XR-70


VICTAULIC END

Notes:

- ☐ H = Valve Body O.D.
- ☐ C = Shoulder Diameter
- ☐ G = Groove Diameter
- ☐ Dimensions shown in inches.
- ☐ Size = nominal valve size.
- ☐ This arrangement applies to style "44" victaulic ends only. Victaulic couplings, glands and gaskets are not furnished unless otherwise specified in the contract.
- ☐ This end style available in AWWA Class 150B only.
- ☐ Allow 3½ inches for thrust bearing removal.
- ☐ Larger sizes available upon request.

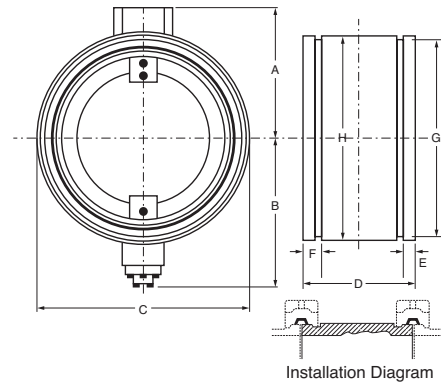

Victaulic End Dimensions								
Size	A	B	C	D	E	F	G	H
24	18 ⁵ / ₈	18 ³ / ₈	27 ⁷ / ₈	12½	1 ³ / ₁₆	2 ³ / ₁₆	26 ¹⁹ / ₃₂	26
30	21½	24 ³ / ₁₆	33 ³ / ₄	18	1¾	2 ²⁵ / ₃₂	33	34 ¹ / ₈
36	25 ⁷ / ₁₆	28 ¹ / ₁₆	40 ³ / ₁₆	22	1¾	2 ²⁵ / ₃₂	39 ⁷ / ₁₆	40 ⁹ / ₁₆
42	29 ⁷ / ₈	32 ¹¹ / ₁₆	46 ⁵ / ₈	22	1¾	3 ¹ / ₃₂	45 ¹³ / ₁₆	47 ⁷ / ₈
48	34 ¹ / ₁₆	36 ⁷ / ₈	53 ⁵ / ₈	24	1¾	3 ¹ / ₃₂	52 ³ / ₁₆	53 ⁵ / ₈
54	37½	40 ¹¹ / ₁₆	59 ¹¹ / ₁₆	24	1¾	3 ⁹ / ₃₂	58 ⁵ / ₈	60 ³ / ₁₆



EXPANSION JOINT ASSEMBLIES FOR TRITON XL BUTTERFLY VALVE

To meet the needs of the power generating and pipeline industries, Henry Pratt Company provides a complete line of expansion joints to accompany our Triton XL butterfly valves or to serve alone for pipeline usage. First developed for circulating water systems, Pratt rubber seated butterfly valves coupled with Pratt expansion joints incorporate design features that ensure long life, ease of operation, minimum maintenance, tight shut-off and reliable performance.

Pratt's expansion joints provide greater movement capability than other competing products. The Pratt Type 88-1, Type 88-2 and Type 88-3 expansion joints allow axial compression and extension, lateral shear and angular bending of + ½ inch at a maximum pressure of 50 psig. Pratt Type 88-4 allows movement of + 1 inch at a maximum pressure of 75 psig. Available in sizes ranging from 30 inches to 144 inches, expansion joints can be supplied with the Triton XL butterfly valve in the following combinations:


- | | |
|---|---|
| <input type="checkbox"/> Flanged by flanged with expansion joint | <input type="checkbox"/> Flanged by weld with expansion joint |
| <input type="checkbox"/> Weld by flanged with expansion joint, or | <input type="checkbox"/> Weld by weld with expansion joint |

The Pratt expansion joint is constructed of natural rubber with a neoprene cover. Alternative materials are available upon request.

Please consult factory for additional information regarding the Pratt Type 88 Expansion Joint.

VALVE END TYPES AND DIMENSIONS: TRITON XL

FLANGE X FLANGE

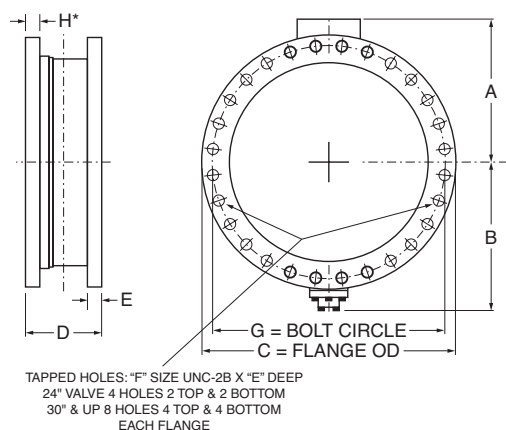

H = Seat side flange for fabricated valves only.

Notes:

- ☐ Triton XL available in cast or fabricated designs.
- ☐ Dimensions shown in inches. "D" dimension $\pm \frac{1}{8}$ ".
- ☐ Size = Nominal valve size.
- ☐ Consult factory for larger than 96".
- ☐ Clearance holes only. Bolt holes are $\frac{1}{8}$ " larger than bolt size for bolts smaller than $1\frac{1}{4}$ ". Bolt holes are $\frac{1}{4}$ " larger than bolt size for bolts $1\frac{1}{4}$ " and larger.
- ☐ Additional height dimensions for replaceable packing bonnet: 10 inches for valves through 60 inches; 11 inches for valves 66 inches and larger,
- ☐ Allow $3\frac{1}{2}$ inches for thrust bearing removal.
- ☐ F = Number and size of bolts. 125 lbs. standard layout. Straddle centerline. * = Applies to both flanges.

50-75 psi

Cast: Size	Flanged End Dimensions						
	A	B	C	D	E*	F	G
78	50	54 $\frac{5}{8}$	93	18	3 $\frac{1}{4}$	64-2	89
84	53 $\frac{1}{8}$	59 $\frac{5}{8}$	99 $\frac{3}{4}$	18	3 $\frac{1}{2}$	64-2	95 $\frac{1}{2}$
90	56 $\frac{1}{2}$	63 $\frac{3}{8}$	106 $\frac{1}{2}$	21	3 $\frac{3}{4}$	68-2 $\frac{1}{4}$	102
96	60 $\frac{5}{8}$	67 $\frac{1}{2}$	113 $\frac{1}{4}$	24	4	68-2 $\frac{1}{4}$	108 $\frac{1}{2}$


50 psi

Fabricated: Size	Flanged End Dimensions							
	A	B	C	D	E	F	G	H
30	21 $\frac{3}{8}$	23 $\frac{7}{8}$	38 $\frac{3}{4}$	12	1 $\frac{3}{8}$	28-1 $\frac{1}{4}$	36	1 $\frac{7}{8}$
36	25 $\frac{1}{2}$	27 $\frac{1}{2}$	46	12	1 $\frac{5}{8}$	32-1 $\frac{1}{2}$	42 $\frac{3}{4}$	2 $\frac{3}{8}$
42	29	32 $\frac{1}{8}$	53	12	1 $\frac{3}{4}$	36-1 $\frac{1}{2}$	49 $\frac{1}{2}$	2 $\frac{3}{8}$
48	32 $\frac{1}{4}$	35 $\frac{5}{8}$	59 $\frac{1}{2}$	15	1 $\frac{1}{4}$	44-1 $\frac{1}{2}$	56	2 $\frac{1}{2}$
54	35 $\frac{5}{8}$	39	66 $\frac{1}{4}$	15	1 $\frac{3}{8}$	44-1 $\frac{3}{4}$	62 $\frac{3}{4}$	2 $\frac{1}{2}$
60	39	43 $\frac{5}{8}$	73	15	1 $\frac{1}{2}$	52-1 $\frac{3}{4}$	69 $\frac{1}{4}$	2 $\frac{1}{2}$
66	43	47 $\frac{1}{8}$	80	18	1 $\frac{5}{8}$	52-1 $\frac{3}{4}$	76	2 $\frac{1}{2}$
72	46 $\frac{1}{4}$	51 $\frac{1}{8}$	86 $\frac{1}{2}$	18	1 $\frac{3}{4}$	60-1 $\frac{3}{4}$	82 $\frac{1}{2}$	2 $\frac{1}{2}$
78	50	54 $\frac{5}{8}$	93	18	2	64-2	89	3
84	53 $\frac{1}{8}$	59 $\frac{5}{8}$	99 $\frac{3}{4}$	18	2	64-2	95 $\frac{1}{2}$	3
90	56 $\frac{1}{2}$	63 $\frac{3}{8}$	106 $\frac{1}{2}$	21	2 $\frac{1}{4}$	68-2 $\frac{1}{4}$	102	3
96	60 $\frac{5}{8}$	67 $\frac{1}{2}$	113 $\frac{1}{4}$	24	2 $\frac{1}{4}$	68-2 $\frac{1}{4}$	108 $\frac{1}{2}$	3


*Contact factory for 150 psi

VALVE END TYPES AND DIMENSIONS: TRITON XL

FLANGE X WELD

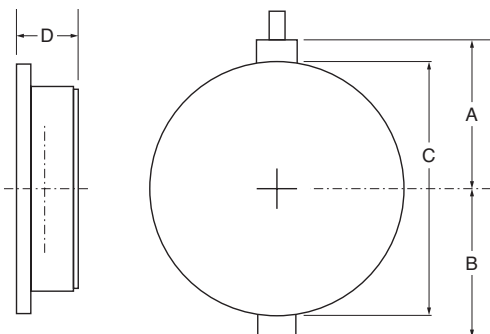

WELD X WELD

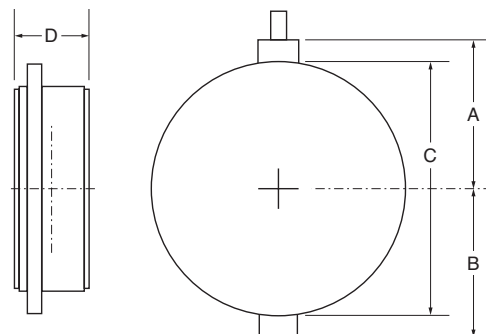

Flange x Weld Dimensions				
Size	A	B	C	D*
30	23½	26⅝	38¾	12
36	25½	28¾	46	12
42	29¼	32⅝	53	12
48	32¼	35⅝	59½	15
54	35⅝	39	66¼	15
60	39	43⅝	73	15
66	43	47⅝	80	18
72	46¼	51⅝	86½	18
78	50	54⅝	93	18
84	53⅝	59⅝	99¾	18
90	56½	63⅝	106½	21
96	60⅝	67½	113¼	24
102	64⅝	70¾	120	26
108	68⅝	74	126¾	28
114	71⅝	77¾	133½	30
120	75⅝	80½	140¼	32
132	83⅝	89	153¾	34
144	90⅝	96½	167¼	38

* Shorter or longer body lengths available.

Weld x Weld Dimensions				
Size	A	B	C	D*
30	23½	26⅝	38¾	16
36	25½	28¾	46	16
42	29¼	32⅝	53	16
48	32¼	35⅝	59½	20
54	35⅝	39	66¼	20
60	39	43⅝	73	20
66	43	47⅝	80	23
72	46¼	51⅝	86½	23
78	50	54⅝	93	23
84	53⅝	59⅝	99¾	23
90	56½	63⅝	106½	26
96	60⅝	67½	113¼	29
102	64⅝	70¾	119	31
108	68⅝	74	124	33
114	71⅝	77¾	130	35
120	75⅝	80½	136½	37
132	83⅝	89	152	39
144	90⅝	96½	165	43

* Shorter or longer body lengths available.

SUGGESTED SPECIFICATIONS FOR BUTTERFLY VALVES 24" AND LARGER CAST CONSTRUCTION

General

All butterfly valves shall be of the tight closing, rubber seated type and fully comply with the latest revision of AWWA Standard C504 and NSF61, where applicable. Valves shall be bubble-tight at rated pressures in either direction, and shall be satisfactory for applications involving throttling service and for applications requiring valve actuation after long periods of inactivity. Valve discs shall rotate 90° from the full open position to the tight shut position. Regardless of valve size, angular misposition of disc can be up to 1° off center without leakage.

The manufacturer shall have manufactured tight closing, rubber seated butterfly valves for a period of at least ten years. All valves from 24" through 72" shall be the Triton XR-70 as manufactured by the Henry Pratt Company or an approved equal. All valves from 78" and larger shall be the Triton XL as manufactured by Henry Pratt Company or an approved equal.

Valve Body

All valve bodies shall be cast iron ASTM A126, Class B, narrow body design. Flange drilling shall be in accordance with ANSI B16.1 standard for cast iron flanges. Body thickness shall be in strict accordance with AWWA C504 where applicable.

Valve Disc

All valve discs shall be constructed of ductile iron ASTM A536 with a stainless steel seating edge. The disc shall not have any hollow chambers that can entrap water. All surfaces shall be visually inspected and measurable to assure all structural members are at full disc strength. Disc and shaft connection shall be made with stainless steel pins.

Valve Shaft

All shafts shall be turned, ground, polished and constructed of ASTM A-276 Type 304 or Type 316 stainless steel. Shafts shall be two-piece, stub type and keyed for actuator connection. Shaft diameters shall meet minimum requirements established by the latest revision of AWWA Standard C504 for their class, where applicable.

TYPICAL APPLICATIONS FOR TRITON XR-70, XL

Thousands of Triton XR-70 and Triton XL butterfly valves have been installed in plants and industrial facilities around the world. Some typical applications include the following:

- | | |
|---|---|
| <input type="checkbox"/> Water treatment | <input type="checkbox"/> Pumping stations |
| <input type="checkbox"/> Wastewater treatment | <input type="checkbox"/> Reservoirs |
| <input type="checkbox"/> Cooling water systems | <input type="checkbox"/> Pipelines |
| <input type="checkbox"/> Circulating water systems | |
| <input type="checkbox"/> Nuclear, fossil fuel and cogeneration power plants | |

Valve Seat

All seats shall be constructed of synthetic rubber compound such as Buna N or EPDM and suitable for bidirectional shutoff at rated pressure. Seats shall be retained in the valve body by mechanical means without retaining rings, segments, screws or hardware of any kind in the flow stream. Seats shall be a full 360° without interruption and have a plurality of grooves mating with a spherical disc edge seating surface. Valve seats shall be field adjustable around the full 360° circumference and replaceable without dismantling the actuator, disc or shaft and without removing the valve from the line.

Valve Bearings

All butterfly valves shall be fitted with sleeve-type bearings. Bearings shall be corrosion resistant and self-lubricating. Bearing load shall not exceed 1/3 of the compressible strength of the bearing or shaft material.

Valve Actuator

Valve actuators shall conform to AWWA Standard C504 and shall be designed to hold the valve in any intermediate position between full open and fully closed without creeping or fluttering.

Painting


All surfaces of the valve shall be clean, dry and free from grease before applying paint or coating. The valve interior and exterior surfaces, except for the seating surfaces, shall be provided with the manufacturer's standard coating unless otherwise specified by contract.

Testing

Hydrostatic and leakage tests shall be conducted in strict accordance with AWWA Standard C504.

Proof of Design

The manufacturer furnishing the valves under the specification shall be prepared to show proof that the valves provided meet the design requirements of AWWA Standard C504.

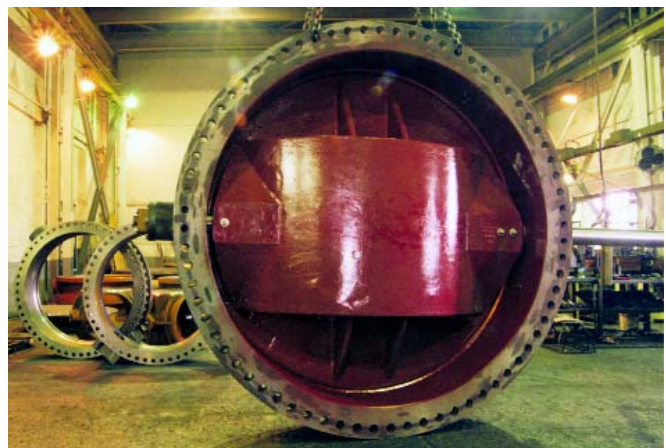

SUGGESTED SPECIFICATIONS FOR BUTTERFLY VALVES 24" AND LARGER FABRICATED CONSTRUCTION

General

All butterfly valves shall be of the tight closing, rubber seated type, and conform to NSF61. Valves shall be bubble-tight at rated pressures in either direction and shall be satisfactory for applications involving throttling service and for applications requiring valve actuation after long periods of inactivity. Valve discs shall rotate 90° from the full open position to the tight shut position. Regardless of valve size, angular misposition of disc can be up to 1° off center without leakage. The manufacturer shall have manufactured tight closing, rubber seated butterfly valves for a period of at least ten years. All valves shall be the Triton XL as manufactured by Henry Pratt Company or an approved equal.

Valve Body

All valve bodies shall be fabricated steel ASTM A36. Valve body shall have internal hubs for housing the shaft bearings and packing gland. Flange drilling shall be in accordance with ANSI B16.1 standard for cast iron flanges up to 72" and AWWA C207 for larger. Weld ends shall be suitable for welding to customer's pipe.

Valve Disc

All valve discs shall be constructed of fabricated steel ASTM A36 with a stainless steel seating edge. The disc shall not have any hollow chambers that can entrap water. All surfaces shall be visually inspected and measurable to assure all structural members are at full disc strength. Disc and shaft connection shall be made with tapered pins of either Monel or stainless steel, threaded at one end and secured with lockwashers and nuts.

Valve Shaft

All shafts shall be turned, ground, polished and constructed of ASTM A276 Type 304 or Type 316 stainless steel for sizes 24" through 96" or ASTM A564, either Type 630 or Type XM25 for sizes 102" through 144". Shafts shall be two-piece, stub type and keyed for actuator connection.

Valve Seat

All seats shall be constructed of synthetic rubber compound such as Buna N or EPDM and suitable for bidirectional shutoff at rated pressure. Seats shall be retained in the valve body by mechanical means without retaining rings, segments, screws or hardware of any kind in the flow stream. Seats shall be a full 360° without interruption and have a plurality of grooves mating with a spherical disc edge seating surface. Valve seats shall be field adjustable around the full 360° circumference and replaceable without dismantling the actuator, disc or shaft and without removing the valve from the line. Manufacturer must certify that rubber seat is field replaceable.

Valve Actuator

Valve actuators shall be designed to hold the valve in any intermediate position between full open and fully closed without creeping or fluttering.

Valve Bearings

All butterfly valves shall be fitted with sleeve-type bearings. Bearings shall be corrosion resistant and self-lubricating. Bear-

ing load shall not exceed 1/5 of the compressible strength of the bearing or shaft material. Bearings shall be nonconducting insulating materials to eliminate the possibility of cathodic corrosion at shaft-to-bearing interface.

Painting and Coatings

All surfaces of the valve shall be clean, dry and free from grease before applying paint or coating. The valve interior and exterior surfaces, except for the seating surfaces, shall be provided with the manufacturer's standard coating or as specified by contract. All internal exposed surfaces that are susceptible to corrosion shall be coated with a Polyimide cured, rust inhibiting epoxy. Surfaces to be coated shall be prepared and sandblasted per Steel Structures Painting Council Specification SSPC-SP-10. Final coating thickness shall be 16 mils minimum. All surfaces shall be inspected for proper dry film thickness using a magnetic dry film thickness gauge. Tests for invisible holidays shall be conducted using a low voltage, wet sponge holiday or leak detector.

Rubber Linings

All internal wetted surfaces of the valve shall be lined with 3/16" thick rubber with a 60 Shore A durometer to resist damage from impact. Surfaces must be prepared and sandblasted per Steel Structures Painting Council Specification SSPC-SP-10. Applied linings shall be visually inspected for air bubbles and checked for invisible holidays at 7,000 volts with a high-voltage spark tester.

Testing

Each valve shall be shop tested for leaks in the closed position with the valve horizontal. The upper surface of the valve disc shall be visible and covered with a pool of water at 0 psi pressure. Air pressure, equivalent to the design rating of the valve, shall be applied to the lower face of the disc for at least five minutes with no indication of leakage (i.e. bubbles in the water pool) during the test period. As an alternative, valves may be given a hydrostatic test at the valve rating pressure. During the test, the valves shall be drop-tight. The minimum duration of the test shall be 5 minutes for valves 20 inches and smaller, and 10 minutes for valves 24 inches and larger.

The valve body shall be hydrostatically tested at twice the rated pressure for ten minutes with the valve in the slightly open position. During this test, there shall be no leakage or seeping through the valve body, weld or valve trunnions.

Testing is in accordance with AWWA C504 latest revision.

Expansion Joints

Expansion joints shall be natural rubber with a Neoprene cover with suitable reinforcing to withstand line pressures of 50 psig at ambient temperatures of 150° F, for Types 88-1,2 and 3 and 75 psig for Type 88-4. Minimum axial and longitudinal movement shall be ± 1/2 inch from the neutral position for Types 88-1,2 and 3. Movement may be ± 1 inch from the neutral position for Type 88-4. The expansion joint shall be clamped by approved means to steel pipe and furnished as a complete assembly, ready for welding to the customer's pipe.


ACTUATION: TRITON XR-70 AND TRITON XL

TRAVELING NUT TYPE MANUAL ACTUATOR

The Pratt MDT manual compound lever-traveling nut type actuator is the ideal manual actuation option for the Triton XR-70 and XL butterfly valves. The MDT provides characterized closure, minimizing the possibility of line shock by slowing down the valve travel as the valve disc approaches the closed position. The high input torque capacity (450 foot pound maximum and a 200 pound pull on the handwheel or chainwheel) provides inherent protection from - actuator misuse.

The Pratt MDT actuator is self locking without a unidirectional sustained force from the valve. It can be relied upon to maintain exact valve position under conditions of fluctuating, turbulent and intermittent flow.

Completely in conformity to the latest revision of AWWA Standard C504, the Pratt Triton valve, coupled with the MDT actuator, offers single source responsibility and reliability for both actuator and valve. To ensure that we can meet the delivery requirements of our valued customers, Pratt maintains an inventory of selected valves equipped with MDT actuators. **Consult factory for availability.**

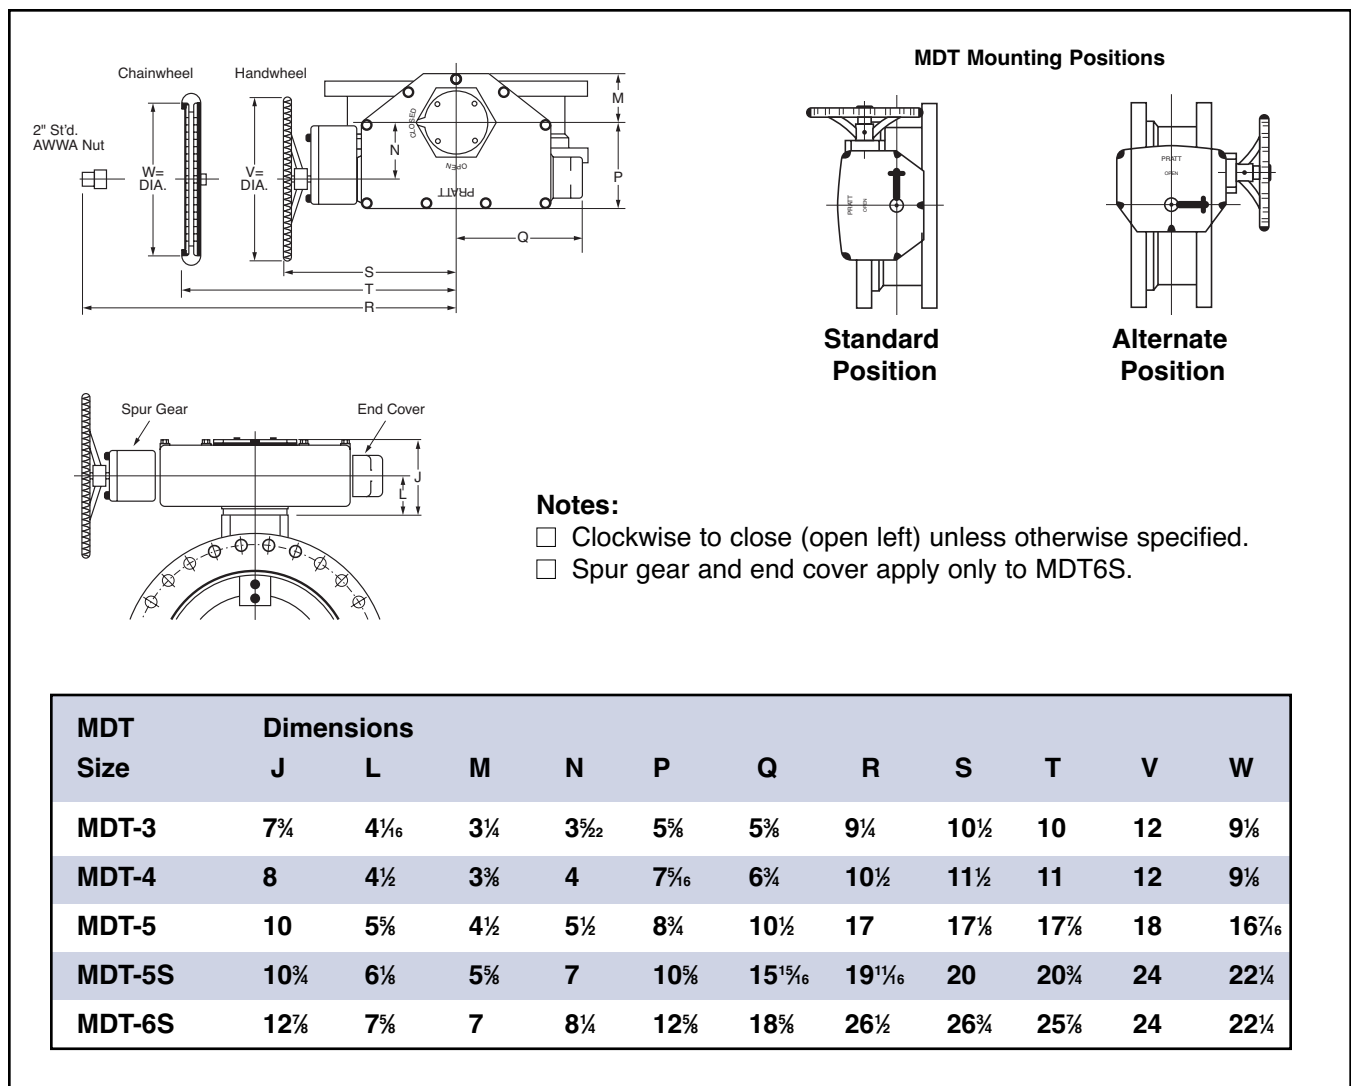

* The Triton XR-70 and XL can be equipped with a wide range of cylinder actuators and electric motor actuators to meet your special operating requirements. Please see Pratt Bulletin ACT-1096 or consult our factory for additional information.

HENRY PRATT COMPANY SALES OFFICES

EAST

BOSTON, MASSACHUSETTS

Bartlett & Brillon LLC
Phone: 508-668-1337
Fax: 508-850-9599

BUFFALO, NEW YORK

J. L. Moore, Inc.
Phone: 716-655-3433
Fax: 716-655-4440

NEW YORK, NEW YORK

Quality Controls, Inc.
Phone: 201-251-9000
Fax: 201-251-9507

PHILADELPHIA, PENNSYLVANIA

John B. Atherholt, Inc.
Phone: 610-828-4140
Fax: 610-828-4199

PITTSBURGH, PENNSYLVANIA

BissNuss, Inc.
Phone: 412-221-1200
Fax: 412-221-5952

YORK, PENNSYLVANIA

Henry Pratt Company
Eastern District Office
Phone: 717-747-0170
Fax: 717-741-6678

SOUTHEAST

ATLANTA, GEORGIA

TEMSCO, Inc.
Phone: 770-614-0194
Fax: 770-614-0325

JACKSON, MISSISSIPPI

Gulf States Engineering Co., Inc.
Phone: 601-922-1364
Fax: 601-922-1774

NASHVILLE, TENNESSEE

Southern Sales, Co., Inc.
Phone: 615-254-0066
Fax: 615-254-0791

NEW ORLEANS, LOUISIANA

Gulf States Engineering Co., Inc.
Phone: 504-243-5500
Fax: 504-243-5508

RICHMOND, VIRGINIA

Engineered Systems and Products, Inc.
Phone: 804-271-7200
Fax: 804-271-8317

ORLANDO, FLORIDA

Diller-Brown
Phone: 407-673-2800
Fax: 407-673-2900

LITTLE ROCK, ARKANSAS

H*E Engineered Equipment Co.
Phone: 501-455-9945
Fax: 501-455-9946

CHARLOTTE, NORTH CAROLINA

EW2 Environmental, Inc.
Phone: 704-542-2444
Fax: 704-542-7003

WEST

DENVER, COLORADO

Pipestone Industrial Co., Inc.
Phone: 303-771-2300
Fax: 303-771-2396

GREAT FALLS, MONTANA

Goble Sampson Associates
Phone: 406-965-2536
Fax: 406-965-2520

KAILUA, HAWAII

CBC, Inc.
Phone: 808-263-8838
Fax: 808-261-4778

SALT LAKE CITY, UTAH

W-Cubed
Phone: 801-466-3819
Fax: 801-466-3850

SCOTTSDALE, ARIZONA

Henry Pratt Company
Western District Office
Phone: 480-391-0564
Fax: 480-451-1472

LOS ANGELES, CALIFORNIA

Southwest Valve & Equipment, Inc.
Phone: 714-832-1090
Fax: 714-832-1091

SEATTLE, WASHINGTON

Beaver Equipment Company
Phone: 425-398-8082
Fax: 425-398-8570

SAN FRANCISCO, CALIFORNIA

Southwest Valve LLC
Phone: 559-322-4715
Fax: 559-322-4703

SOUTHWEST

DALLAS, TEXAS

Manufactured Valve Products, Inc.
Phone: 972-681-2200
Fax: 972-681-0066

HOUSTON, TEXAS

Scruggs Company
Phone: 713-649-2776
Fax: 713-649-1975

PHOENIX, ARIZONA

C.J. Raleigh and Associates
Phone: 623-972-9238
Fax: 623-972-9250

MIDWEST

CHICAGO, ILLINOIS

Henry Pratt Company
Central District Office
Phone: 630-844-4000
Fax: 630-844-4160

CLEVELAND, OHIO

BissNuss, Inc.
Phone: 440-871-8394
Fax: 440-871-2526

CINCINNATI, OHIO

BissNuss, Inc.
Phone: 513-677-8700
Fax: 513-677-8719

DETROIT, MICHIGAN

Peterson and Matz, Inc.
Phone: 248-476-3204
Fax: 248-476-3445

INDIANAPOLIS, INDIANA

Colley & Associates, Inc.
Phone: 317-254-1001
Fax: 317-251-3272

KANSAS CITY, KANSAS

Mid-America Valve
Phone: 913-642-2442
Fax: 913-642-2878

MILWAUKEE, WISCONSIN

Peterson & Matz
Phone: 715-355-1436
Fax: 715-355-1437

MINNEAPOLIS, MINNESOTA

Plant & Flanged Equipment Co.
Phone: 763-792-3870
Fax: 763-792-3876

OMAHA, NEBRASKA

Bert Gurney & Associates, Inc.
Phone: 402-551-7995
Fax: 402-553-5879

ST. LOUIS, MISSOURI

Vandevanter Engineering Co.
Phone: 636-343-8880
Fax: 636-343-1720

TULSA, OKLAHOMA

H*E Engineered Equipment Co.
Phone: 918-251-2121
Fax: 918-251-1051

*Contact Pratt headquarters for sales representative offices
serving the power and international market places.*

PRATT

MISSION STATEMENT


















*To design and manufacture valves for fluid service that
exceed our customers' quality and delivery expectations.*

Pratt History >

Engineering >

Products >

Specifications >

<http://www.henrypratt.com/>**PRATT PRODUCT GUIDE****Model
2FII****Triton
HP250****Triton
XR70****Control
Systems****Triton
XL****Metal Seated
Ball Valve****Rectangular****Plug
Valve****Rubber Seated
Ball Valve****Tilting Disc
Check Valve****Groundhog
Valve****Cone Valve****Monoflange
MKII****Sleeve Valve****Indicating
Butterfly Valve
UL & FM approved****Sluice Gate****N-Stamp Nuclear
Butterfly Valve****PIVA Post Indicating
Valve Assembly
UL & FM approved****PRATT****Henry Pratt Company**

401 South Highland Avenue

Aurora, Illinois 60506-5563

Toll Free 877-436-7977

630-844-4000

Fax 630-844-4160

www.henrypratt.com

©2005 Henry Pratt Company

Printed in the U.S.A.

BFV24-0305